


Imperial [IP] Dimensions  
Metric (SI) in Parentheses

CARNES COMPANY 448 S. Main St., P. O. Box 930040, Verona, WI 53593-0040 Phone: (608)845-6411 Fax: (608)845-6504 www.carnes.com

### RIGHT HAND SHOWN.

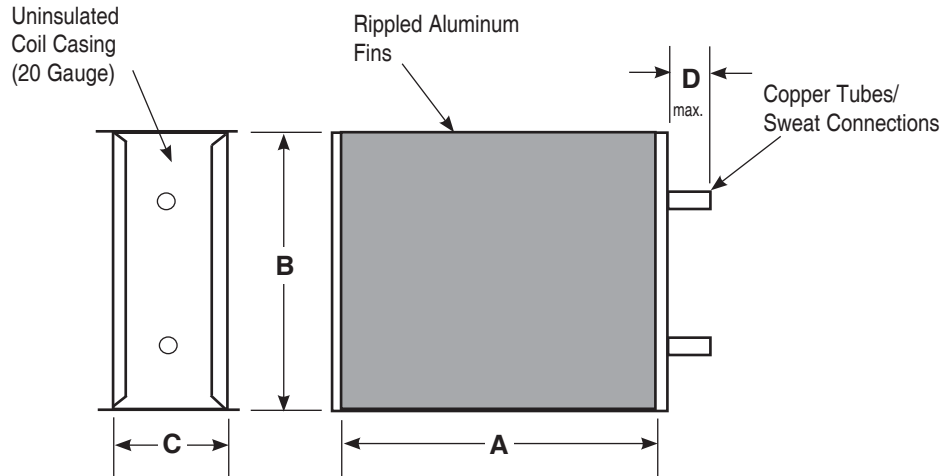

### STANDARD FEATURES:

- Slip & Drive Discharge Connection
- AHRI 410 Certified
- 10 F.P.I.
- 1/2" Copper Tubing
- 20 Gauge Galvanized Steel Casing
- Wall Thickness of .016"
- 1-1/4" x 1.08" Rippled Aluminum Fins
- Fin Thickness of .0055"
- Type "L" Copper
- Tested To 350 P.S.I. Underwater

### OPTIONS:

- Special Construction \_\_\_\_\_
- Special Construction \_\_\_\_\_
- Special Construction \_\_\_\_\_
- Exceptions \_\_\_\_\_

Unit & Size					Coil Size		C		D		O.D. Coil Connection	
AVW	ABW	ACWH/ASWH	ACWQ	ACWJ	A	B	1 Row	2 Row	1 Row	2 Row	1 Row	2 Row
5/6	---	---	---	---	12	8	3-1/8	4-1/2	3	3	1/2	1/2
7/8	6/7/8	---	---	---	12	10	3-1/8	4-1/2	3	3	1/2	5/8
---	---	---	A, B, C	---	14	10	3-1/8	4-1/2	3	3	1/2	5/8
10	10	A, B, C, D	D	B, C, D	14	12-1/2	3-1/8	4-1/2	3	3	1/2	5/8
12	12	E, F	E, F	E, F	16	15	3-1/8	4-1/2	3-1/2	4	5/8	7/8
14	14	---	---	---	20	17-1/2	3-1/8	4-1/2	3-1/2	4	5/8	7/8
16	16	---	---	---	24	18	3-1/8	4-1/2	3-1/2	4	5/8	7/8
18/24	18/24	---	---	---	32	17-1/2	3-1/8	4-1/2	3-1/2	4	5/8	7/8
---	---	---	---	G	24	17-1/2	3-1/8	4-1/2	3-1/2	4	5/8	7/8
---	---	---	---	H, J	42	17-1/2	3-1/8	4-1/2	3-1/2	4	5/8	7/8


Unit & Size					Coil Size		C		D		O.D. Coil Connection	
AVW	ABW	ACWH/ASWH	ACWQ	ACWJ	A	B	1 Row	2 Row	1 Row	2 Row	1 Row	2 Row
5/6	---	---	---	---	305	203	79	114	76	76	13	13
7/8	6/7/8	---	---	---	305	254	79	114	76	76	13	16
---	---	---	A, B, C	---	356	254	79	114	76	76	13	16
10	10	A, B, C, D	D	B, C, D	356	318	79	114	76	76	13	16
12	12	E, F	E, F	E, F	406	381	79	114	89	102	16	22
14	14	---	---	---	508	445	79	114	89	102	16	22
16	16	---	---	---	610	457	79	114	89	102	16	22
18/24	18/24	---	---	---	813	445	79	114	89	102	16	22
---	---	---	---	G	609	445	79	114	89	102	16	22
---	---	---	---	H, J	1066	445	79	114	89	102	16	22

Job Name \_\_\_\_\_ Contractor \_\_\_\_\_  
 Architect \_\_\_\_\_ Submitted By \_\_\_\_\_  
 Engineer \_\_\_\_\_ Tag/Mark \_\_\_\_\_

Imperial [IP] Dimensions  
Metric (SI) in Parentheses

CARNES COMPANY 448 S. Main St., P. O. Box 930040, Verona, WI 53593-0040 Phone: (608)845-6411 Fax: (608)845-6504 www.carnes.com

### RIGHT HAND SHOWN.

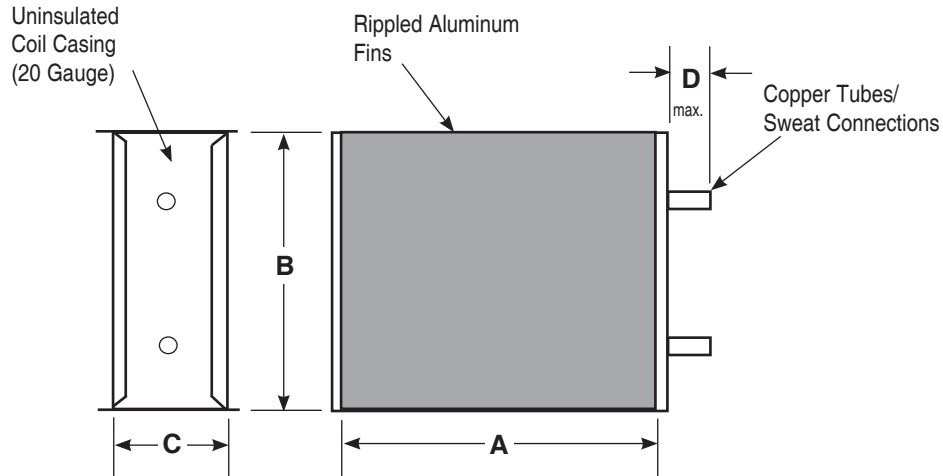

### STANDARD FEATURES:

- Slip & Drive Discharge Connection
- AHRI 410 Certified
- 10 F.P.I.
- 1/2" Copper Tubing
- 20 Gauge Galvanized Steel Casing
- Wall Thickness of .016"
- 1-1/4" x 1.08" Rippled Aluminum Fins
- Fin Thickness of .0055"
- Type "L" Copper
- Tested To 350 P.S.I. Underwater

### OPTIONS:

- Special Construction \_\_\_\_\_
- Special Construction \_\_\_\_\_
- Special Construction \_\_\_\_\_
- Exceptions \_\_\_\_\_

Unit & Size					Coil Size		C		D		O.D. Coil Connection	
AVW	ABW	ACWH/ASWH	ACWQ	ACWJ	A	B	3 Row	4 Row	3 Row	4 Row	3 Row	4 Row
5/6	---	---	---	---	12	8	5-7/8	7-1/4	3-1/2	3-1/2	7/8	7/8
7/8	6/7/8	---	---	---	12	10	5-7/8	7-1/4	3-1/2	3-1/2	7/8	7/8
---	---	---	A, B, C	---	14	10	5-7/8	7-1/4	3-1/2	3-1/2	7/8	7/8
10	10	A, B, C, D	D	B, C, D	14	12-1/2	5-7/8	7-1/4	3-1/2	3-1/2	7/8	7/8
12	12	E, F	E, F	E, F	16	15	5-7/8	7-1/4	3-1/2	4	7/8	7/8
14	14	---	---	---	20	17-1/2	5-7/8	7-1/4	3-1/2	4	7/8	7/8
16	16	---	---	---	24	18	5-7/8	7-1/4	3-1/2	4	7/8	7/8
18/24	18/24	---	---	---	32	17-1/2	5-7/8	7-1/4	3-1/2	4	7/8	7/8
---	---	---	---	G	24	17-1/2	5-7/8	7-1/4	3-1/2	4	7/8	7/8
---	---	---	---	H, J	42	17-1/2	5-7/8	7-1/4	3-1/2	4	7/8	7/8

Unit & Size					Coil Size		C		D		O.D. Coil Connection	
AVW	ABW	ACWH/ASWH	ACWQ	ACWJ	A	B	3 Row	4 Row	3 Row	4 Row	3 Row	4 Row
5/6	---	---	---	---	305	203	149	184	89	89	22	22
7/8	6/7/8	---	---	---	305	254	149	184	89	89	22	22
---	---	---	A, B, C	---	356	254	149	184	89	89	22	22
10	10	A, B, C, D	D	B, C, D	356	318	149	184	89	89	22	22
12	12	E, F	E, F	E, F	406	381	149	184	89	102	22	22
14	14	---	---	---	508	445	149	184	89	102	22	22
16	16	---	---	---	610	457	149	184	89	102	22	22
18/24	18/24	---	---	---	813	445	149	184	89	102	22	22
---	---	---	---	G	609	445	149	184	89	102	22	22
---	---	---	---	H, J	1066	445	149	184	89	102	22	22

Job Name \_\_\_\_\_ Contractor \_\_\_\_\_  
 Architect \_\_\_\_\_ Submitted By \_\_\_\_\_  
 Engineer \_\_\_\_\_ Tag/Mark \_\_\_\_\_